



HP R1500 G3 UPS Firmware v1.08 Update



1. Setup flash application.


Click “GP32Flash2.04.exe” to install the flash upgrade program, “GP32” is the processor family designator and 2.04 is the version of the update program, the following window will show.

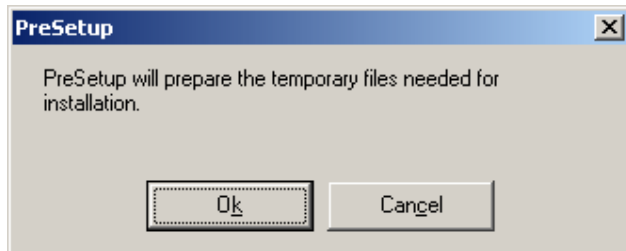


Click OK button

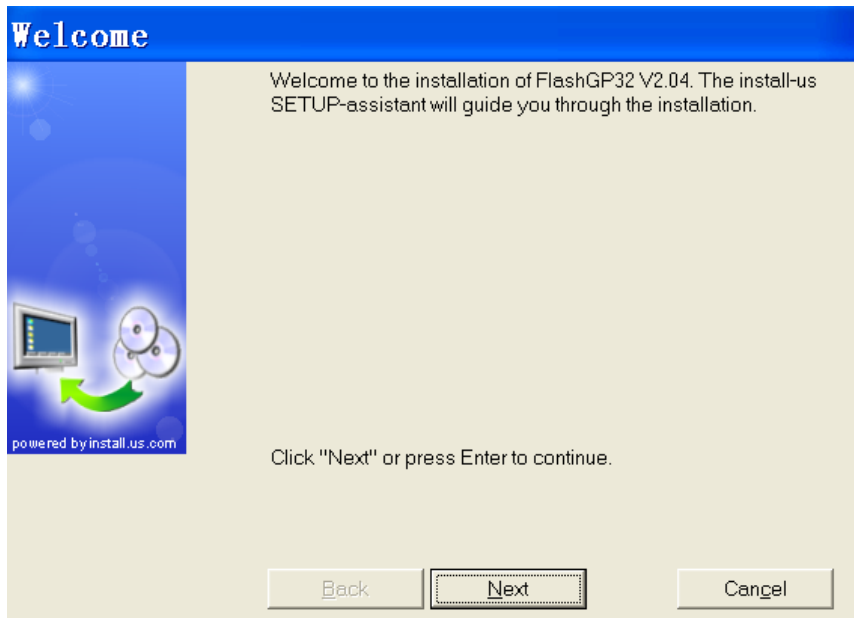

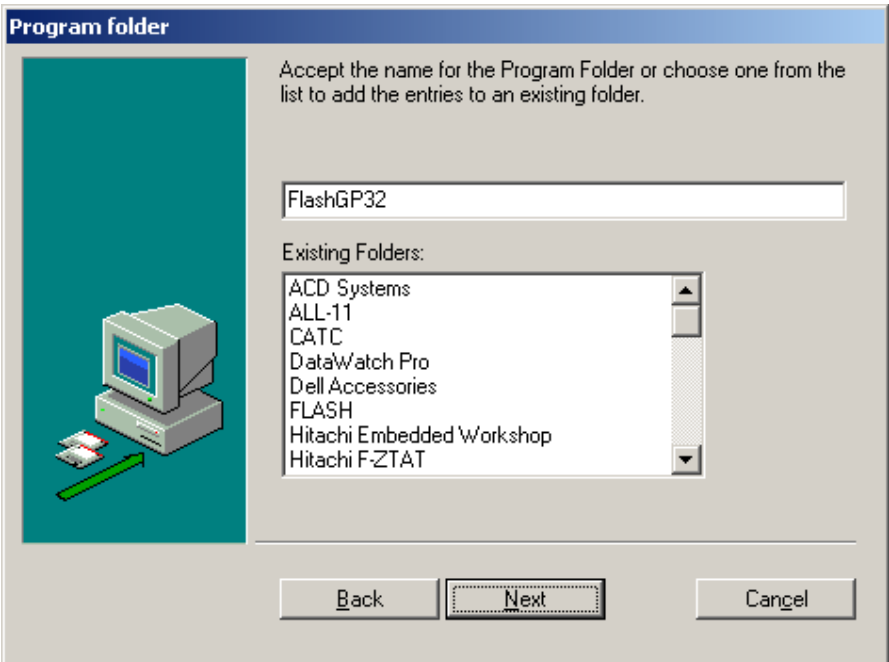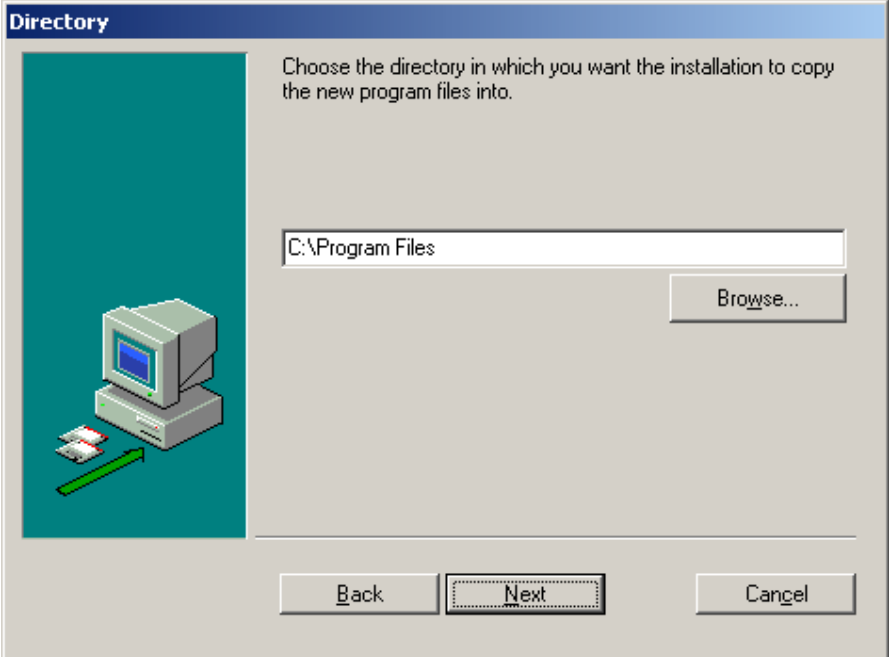

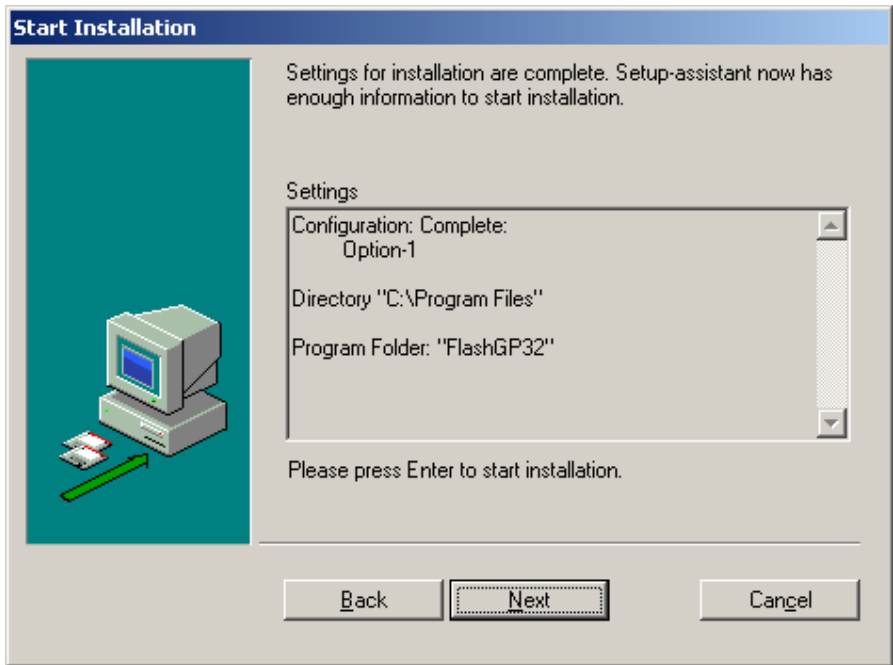



Click next button until installation complete window show.

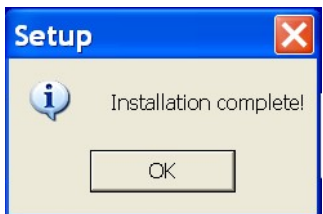

Continued next page


2. Update UPS firmware

- 2.1. Double click 'FlashGp32.exe' to open the Flash program
- 2.2. Use the RS232 cable to connect the COM ports between UPS and computer.
- 2.3. Utility power plug in, please do not turn on the UPS.
- 2.4. The following window will appear. Select the correct COM port. Then click the **Open** button to select the file that will be flashed (*.s19), then click OK button.

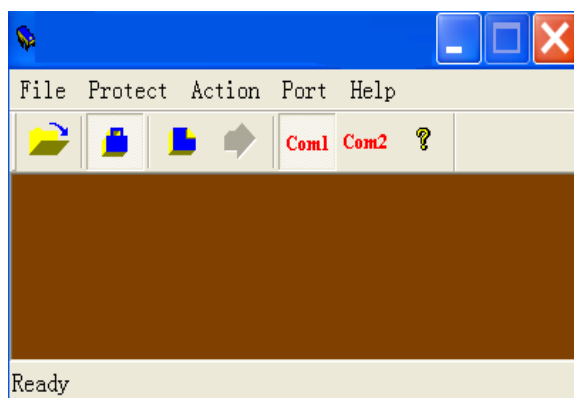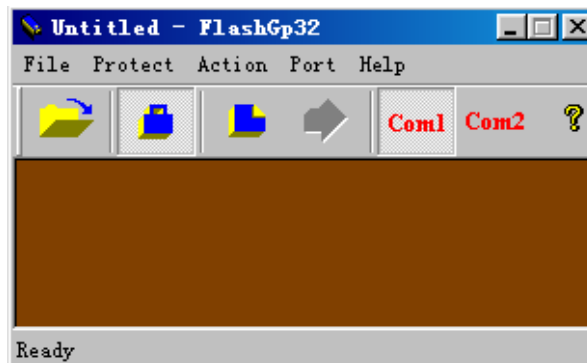


Continued next page


2.5. After the flashed file has been loaded, press on the 'Set Ready' button to be ready for programming.

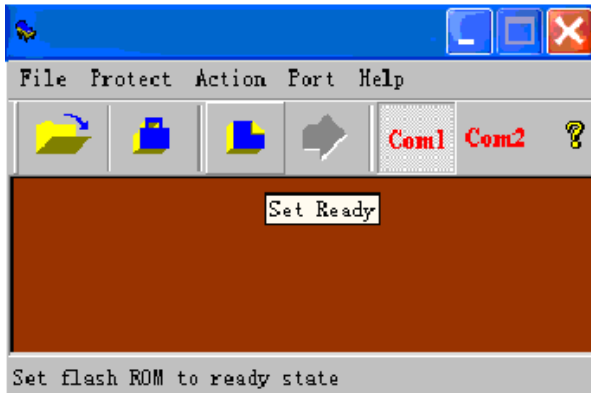


2.6. Push on **Send** button to begin the flash.

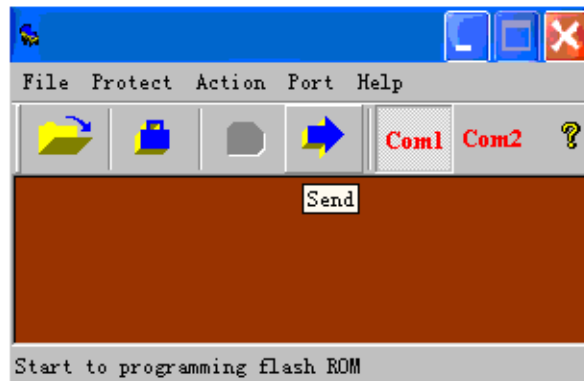

2.7. The follow figure shows the progress of the programming.

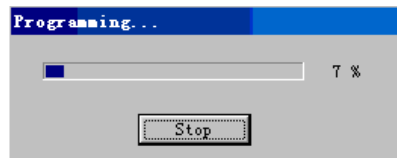

2.8. When the Programming is successful, the following window will be shown. Press on the **OK** button, and close the application to complete the flashing.

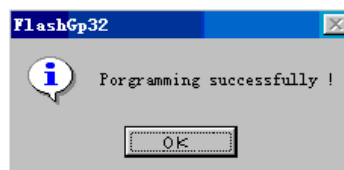

Repeat step 2.1 when you change another UPS.